Zingonia
Fan test laboratory
AMCA 210/99 Fig. 12
50.000 m^3/h test chamber

Air Density (γ): 1.20 kg/m^3
Installation type " B" : free inlet, ducted outlet
dB(A) free field noise measurements at 1 m

Type:	DD 12/9	Watt:	2200	Amp Max:	7
Motor:	1429F9	Volt:	400 3~ (Y)	Prot.:	IP 55
Test nr.:	3319.*	Hz:	50	T.H.:	NO
Date:	19/09/07	Poles:	4	Ins. Cl.:	F

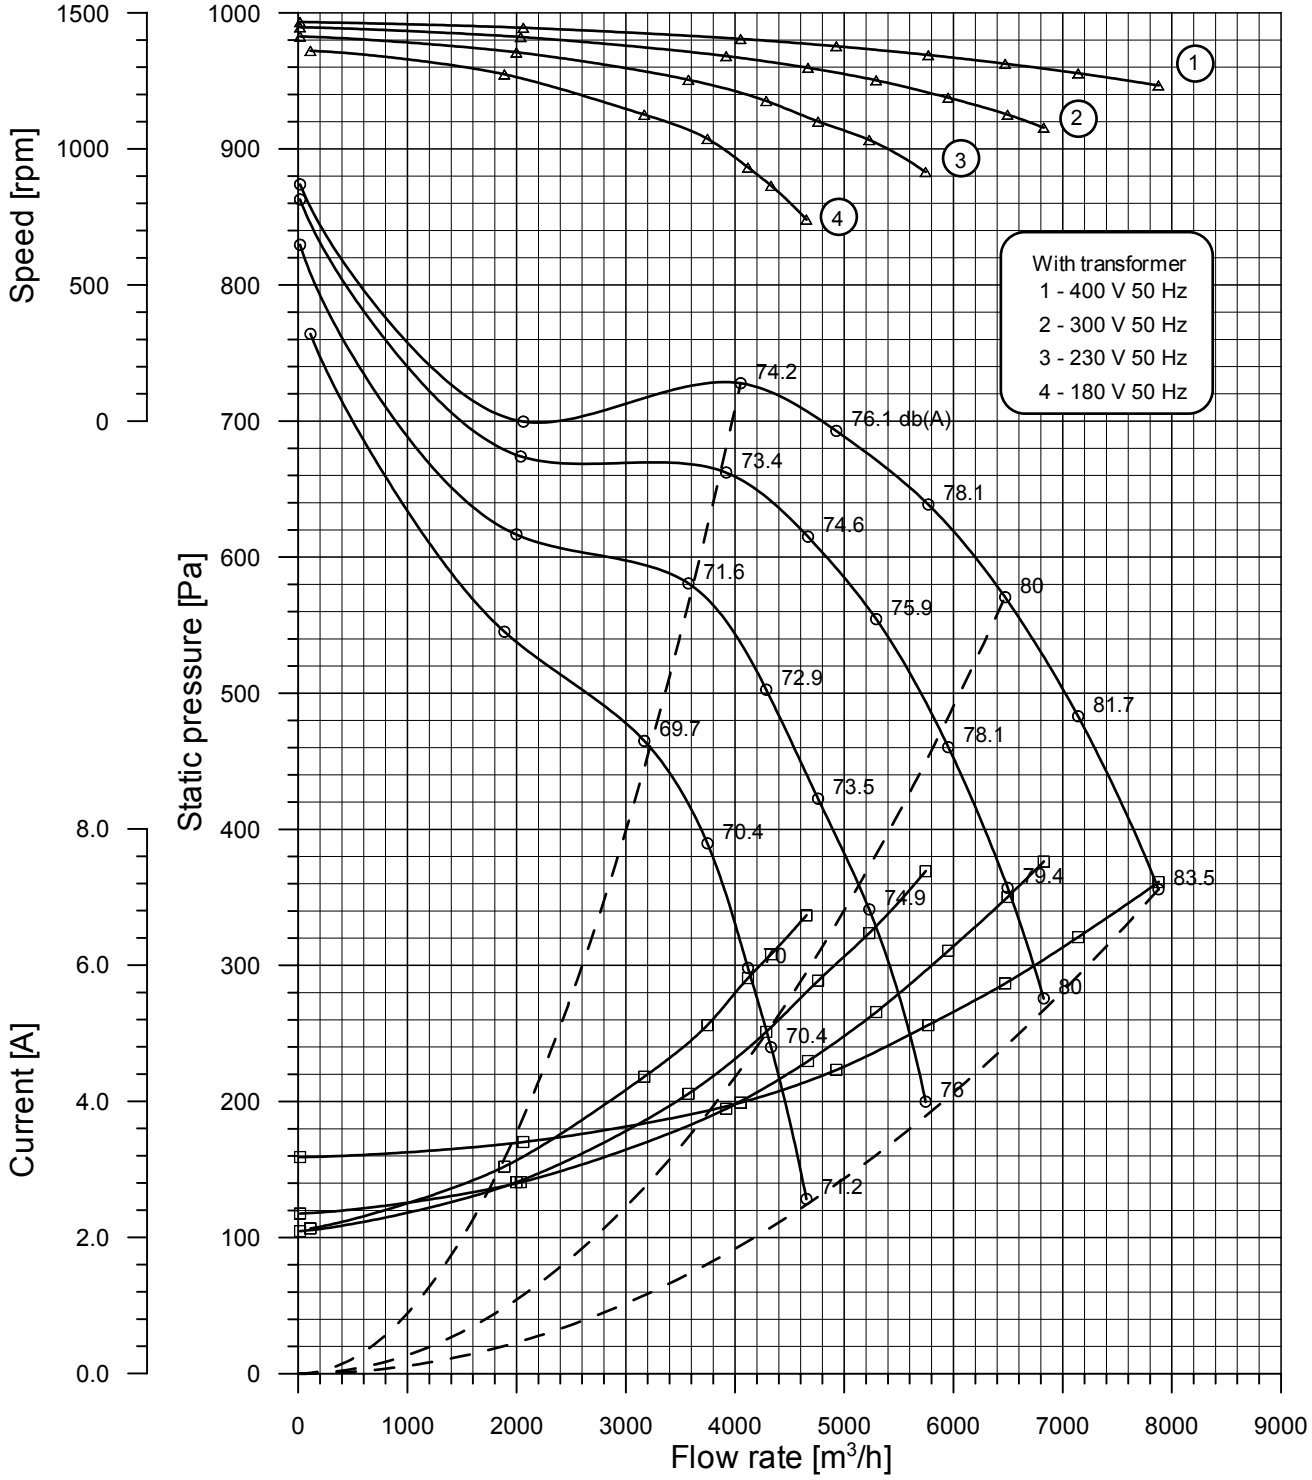

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.