


Zingonia 10000 m³/h test chamber
 Fan test laboratory AMCA 210/99 Fig. 12

Type:	DDMP 8/9 Tight	Watt:	400	Amp Max:	
Motor:	New Motor Design	Volt:	230 1~	Prot.:	IP 44
Test nr.:	S4574.*	Hz:	50	T.H.:	NO
Date:	12/02/2014			Ins. Cl.:	F

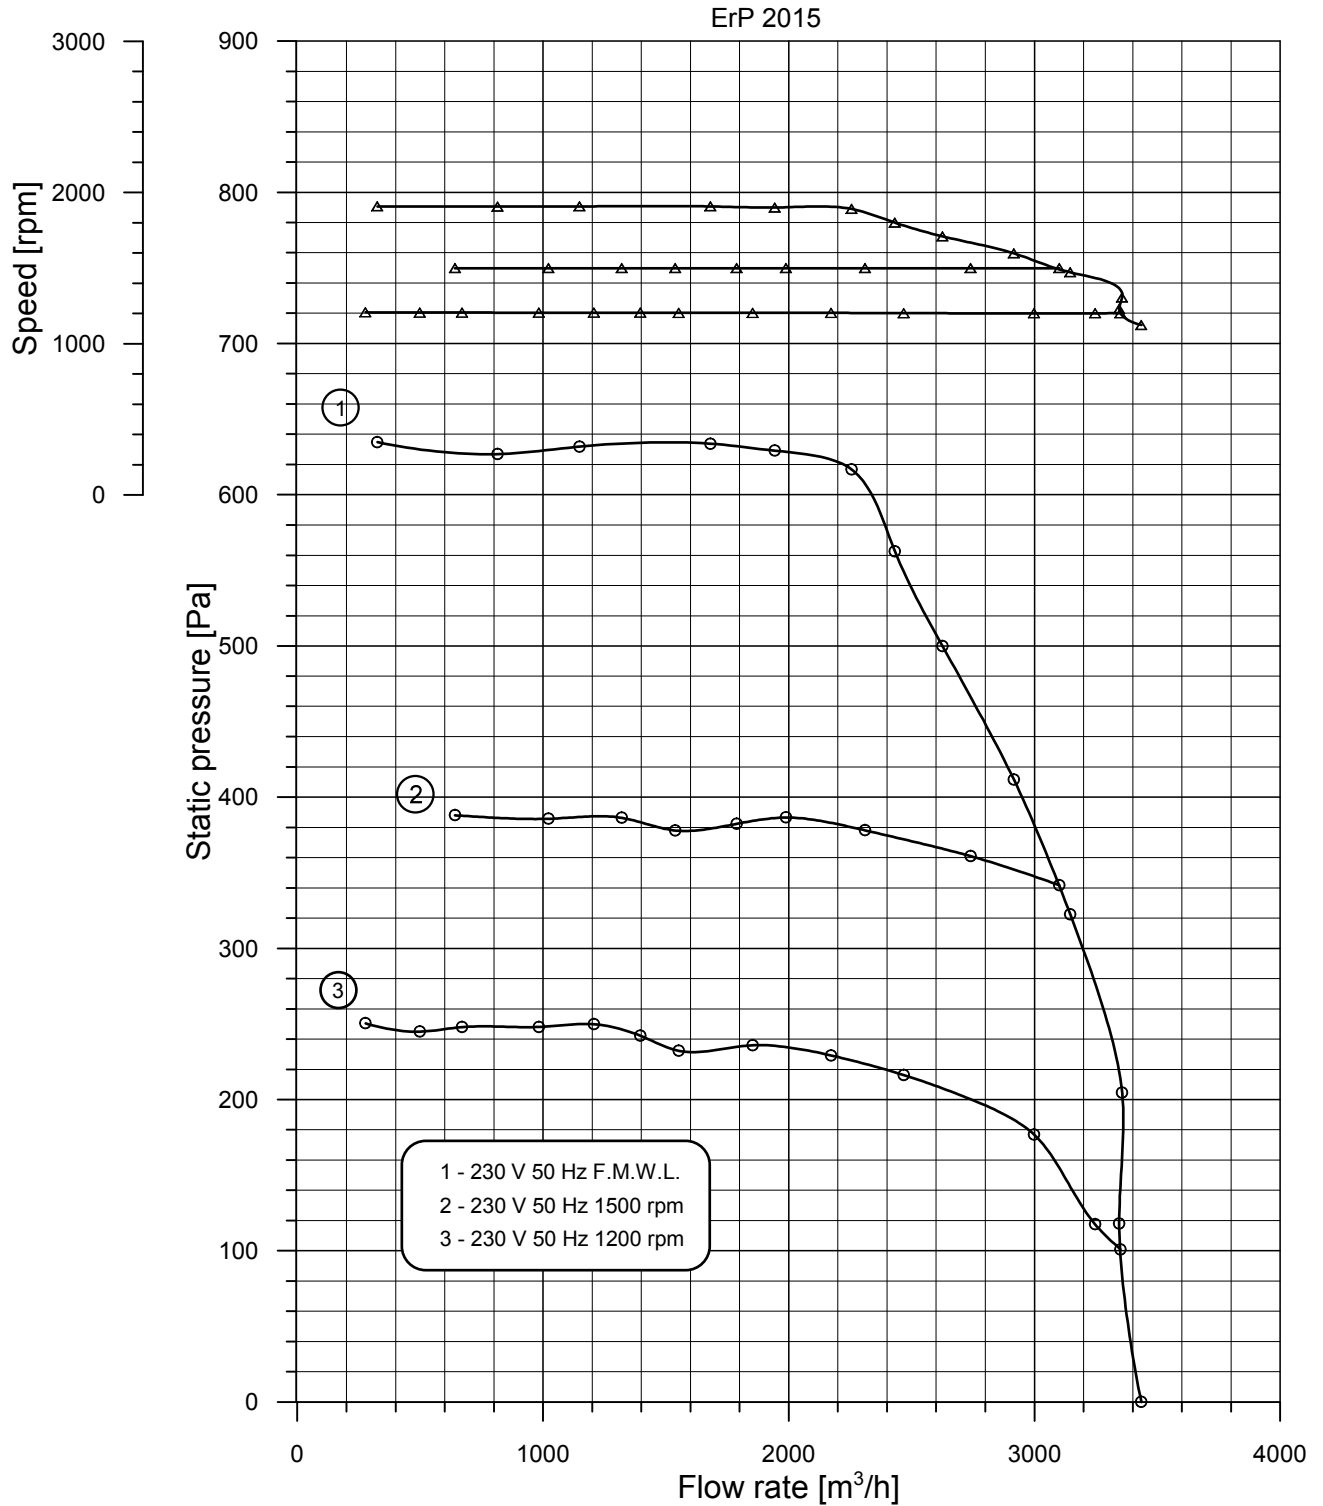

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.